# Peak shaving

Our energy infrastructure is a very fragile and sophisticated system. There needs to be sufficient energy to meet demand at all times. We as users must not be affected by this, because who wants to think about whether to take a shower or put a pizza in the oven?

To enable planners to respond to volatile demand, standard load profiles for various consumer groups have been created based on a multitude of data from trade associations and network operators. This makes it possible to estimate the energy and power demand relatively well and cover it by means of the available power plants.


## Capping peak loads at the grid connection point

Due to their large number of consumers, hotels, supermarkets and DIY stores have a high electricity demand. This can be completely or partially covered by using a photovoltaic system with electricity storage. This reduces the electricity demand from the grid and lowers CO<sub>2</sub> emissions.


But these institutions also have other problems: due to the high number of consumption points, the base load that these consumers permanently draw from the grid is very high. In addition, spikes in consumption can occur as a result of people switching on or temporarily operating other high loads.

To serve these consumption spikes or peak loads, capacities must be kept available in the infrastructure for our energy network.

This in turn has to be paid by the consumer through a separate fee in the form of a capacity charge. Depending on the region and grid operator, this capacity charge ranges between €40 and €180 per kilowatt (kW) provided. The charge can very quickly become a high proportion of the total electricity costs.

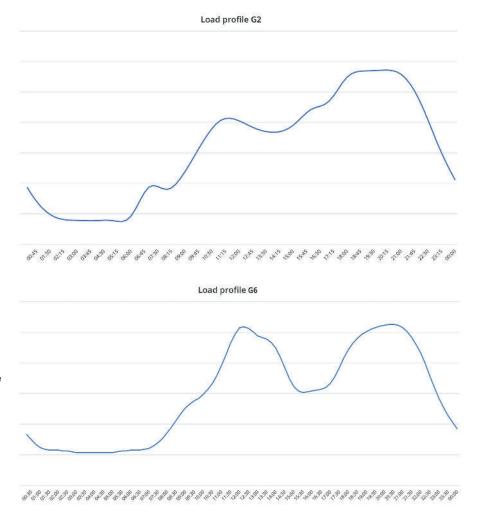



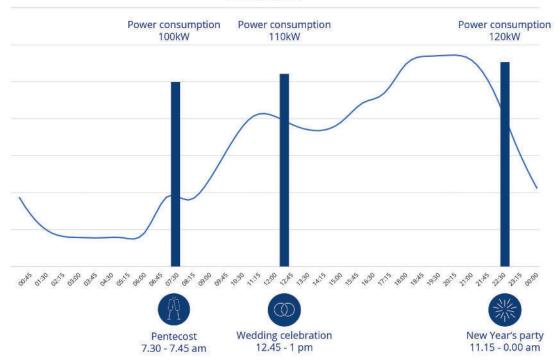

Annual average = 100 kW > Costs for hotelier at a performance price of €102 per kW/year = €11,200.

For hotels, supermarkets and DIY stores, the development of e-mobility becoming increasingly important.

This has two aspects. Firstly, by enabling customers to charge e-vehicles on site, e.g. during their stay or when shopping, customer service can be improved and thus customer loyalty can be enhanced. This in turn can generate higher sales.

Secondly, these additional consumers create extra demand on the connected load and further power peaks at the grid connection. This adversely affects the energy costs and increases capacity charges, or creates the need to further expand the grid connection, which can quickly incur considerable costs.

Example: costs for providing more power to 5 charging stations

Current grid connection

power: 180 kW

Current capacity charge: €85 per kW

Costs for providing power: €15,300 pa

5 charging stations, each with 22 kW charging power

5 x 22 kW = 110 kW

The assumed simultaneity factor according to DIN VDE 0100-722 corresponds to factor 1

New grid connection power: 110 kW + 180 kW = 290 kW


Costs for providing power: €24,650 pa Additional costs due to e-charging infrastructure: €9,350 pa


The simultaneity factor of 1 required by the standards is problematic in this analysis. This assumes that in extreme cases all charging stations are operated at maximum power. However, this case is hardly achievable in reality, as the charging stations will be charging at different powers at all times and charging will not always take place at all charging stations.

But the power of the sun in the form of a photovoltaic installation can also help here. By using a PV system in conjunction with a large storage unit and a clever control system, the connected load at the grid interconnection point can be reduced.

Solar-Log has developed a solution that makes this possible. Our existing high compatibility with various components on the market enables us to regulate a large number of components with one another. This is particularly true for PV systems and the inverters installed in them.

By using the Solar-Log control system for peak shaving and load management, the PV system can be used in conjunction with a qualified\* commercial storage unit to reduce the connected load at the grid connection point and continue using sustainable energy for e-mobility.





The Solar-Log Base enables users to not only monitor their PV systems or realise a grid-compliant connection to the medium-voltage grid; with the new control system, they can also include an e-charging infrastructure and a commercial storage unit in the intelligent load management.

#### Is it worthwhile?

Let's assume that the user succeeds in reducing the connected load by 60 kW, by using the Solar-Log control system. What effects would this have? Firstly, the power actually required from the grid is reduced, which provides active relief in the grid and helps ensure a stable energy infrastructure. 60 kW less power demand also means a reduced capacity charge: in our case: 60 kW \* €85/kW/pa = €5,100 per annum. By using an intelligent control system, the simultaneity factor of '1' may be reduced according to DIN VDE 0100-722, e.g. to 0.75, since it is assumed that only 75% of the maximum power is consumed simultaneously.

#### Result from our example


110 kW connected load for the e-charging infrastructure with simultaneity factor 0.75 -> 82.5 kW maximum connected load


Reduction of the total connected load by 60 kW -> 202.5 kW new maximum grid connection power.

New capacity charge: €17,212 pa

 $Savings\ compared$ 

with before: €7,438 pa

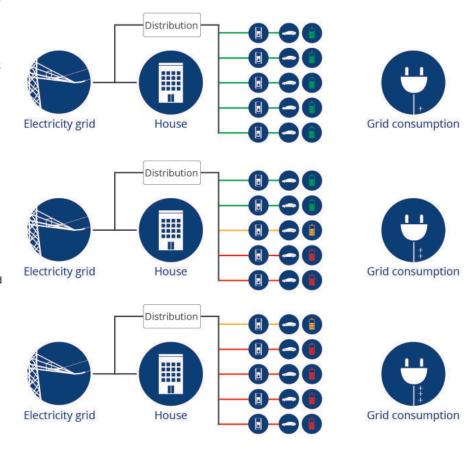

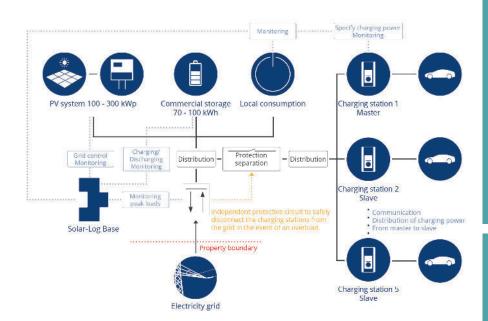

### Advantages at a glance

- A solution for monitoring grid connection and peak shaving / load management
- High compatibility with PV inverter systems for maximum flexibility
- Clever control for making maximum use of PV energy and reducing grid connection power
- Cost savings and increased convenience for your customers
- Active support of the energy transition and energy grid
- www.solar-log.com/en

#### Solar-Log Intersolar 2022 Munich:

1th - 13th May

Hall B5 - Booth 520

https://www.solar-log.com/en/company/trade-fair-and-exhibition-dates/